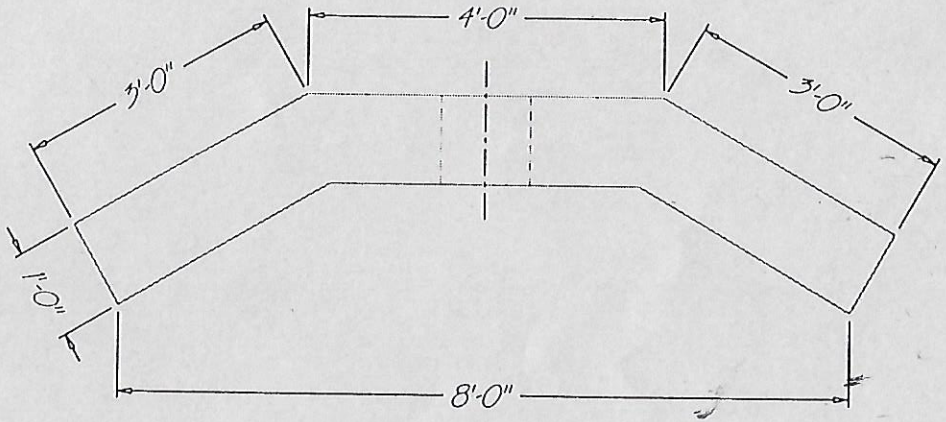


PLAN VIEW

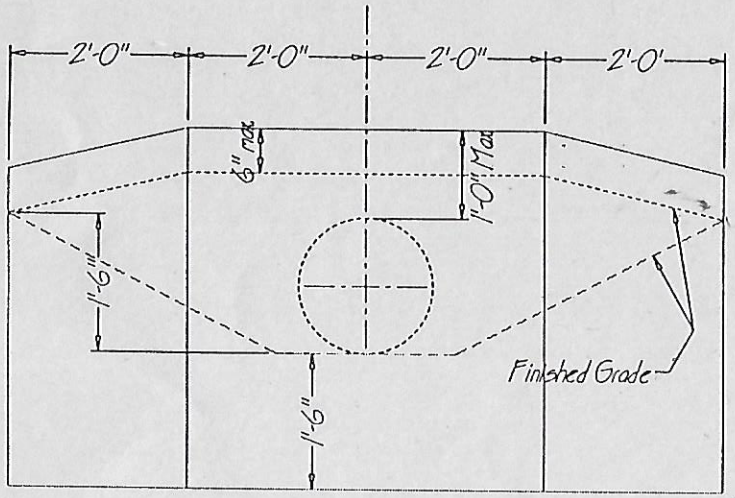


FRONT VIEW

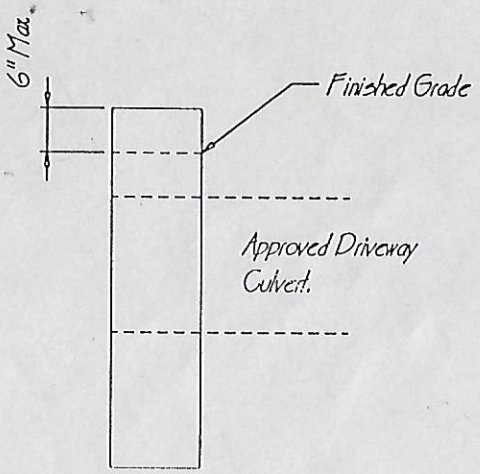


SECTION VIEW

NOTES:

1. Culvert size, grade, depth, cover, and material to be approved by the Warren County Engineer.
2. Footing shall extend a minimum of 18" into virgin soil. Material shall be a minimum 1000 psi compacted strength.
3. Headwalls shall be constructed of "Latham" limestone as approved by the developer.
4. All ditches shall be restored including grading and sod as required by the Warren County Engineer.
5. Headwalls shall protrude a maximum of 6" above finished grade.
6. Top of headwall shall be a maximum of 1'-0" above top of culvert.

BOOK 1863 PAGE 808

WARREN COUNTY ENGINEERS OFFICE
105 MARKEY ROAD LEBANON, OHIO 45036
Phone: (513) 933-1364 Fax: (513) 933-2967

| | | | |
|---|---|---|---|
| DRAWN: JKP | DATE: 12/22/97 | PROJECT: TYPICAL VIEW OF CONCRETE HEADWALL | SHEET NAME: HEADWALL TYPICAL |
| CHECKED: Greg Carmack | 12/22/97 | | |
| DESIGNED: Neil F. Tuscano P.E., P.S. | 12/22/97 | FILENAME: NAME CONCRETE HEADWALL DETAILS.DWG DATE: DEC 22, 1997 TIME: 1:30 PM | |
| APPROVED: Neil F. Tuscano P.E., P.S. | 12/22/97 | PLOT DATE: December 22, 1997 @ 13:55 | SCALE: None | SHEET 1 OF 1 | REVISED: 12/22/97 |